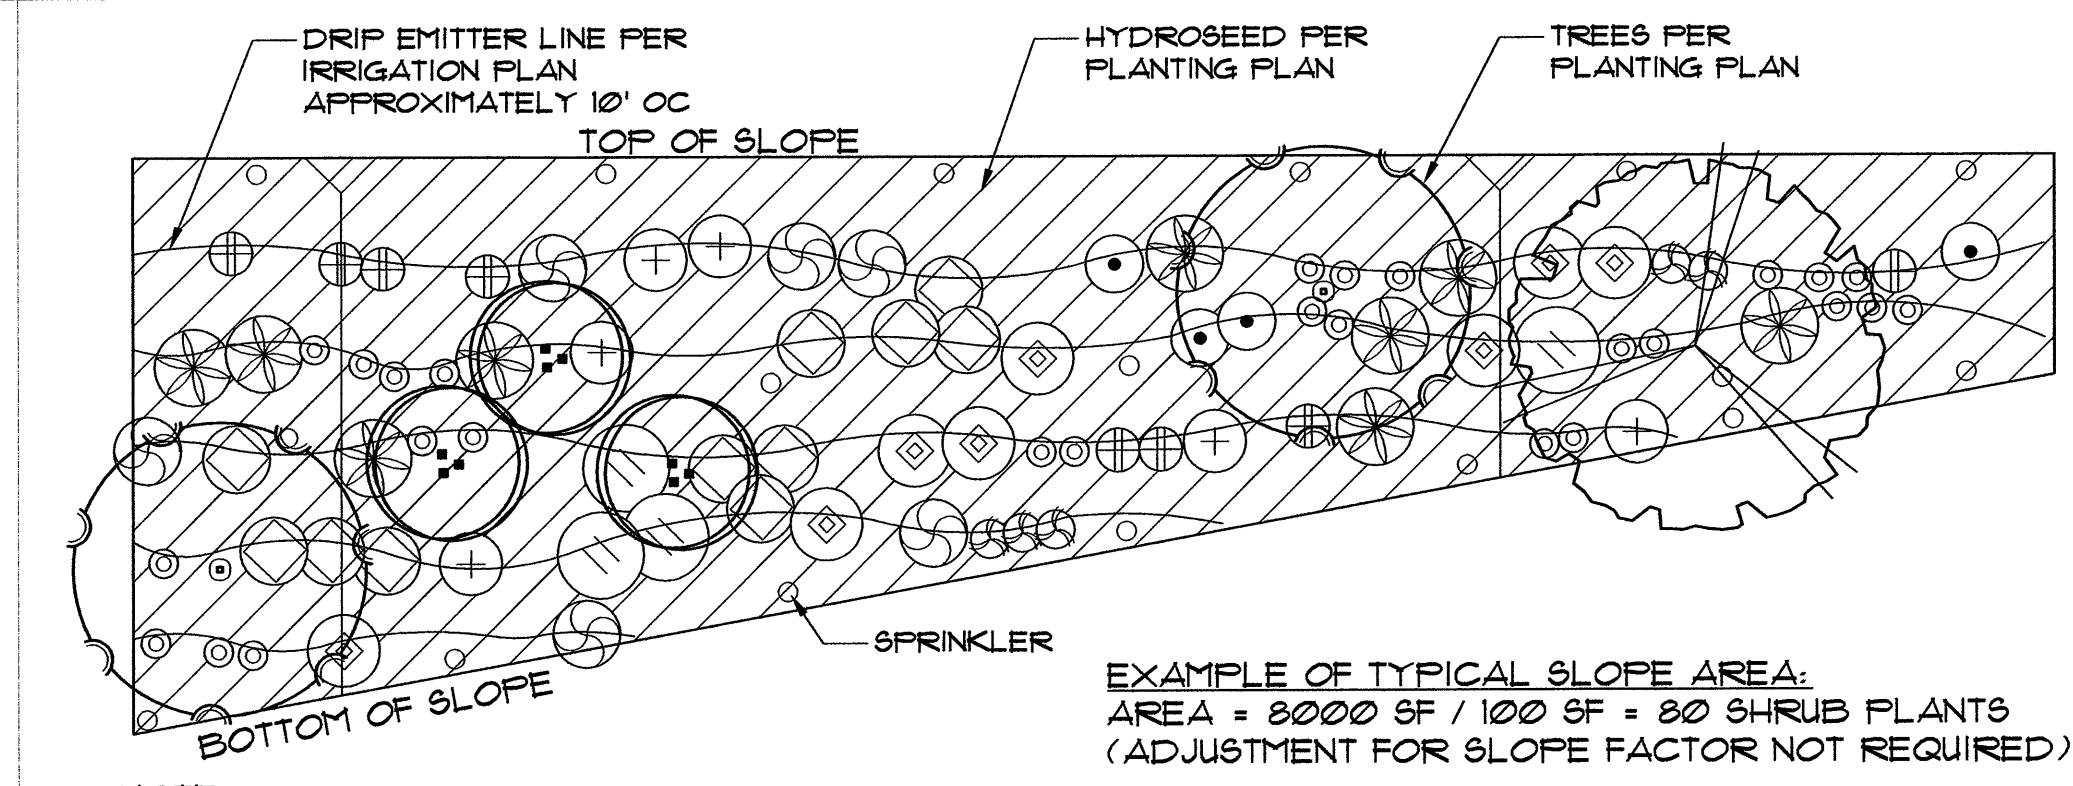
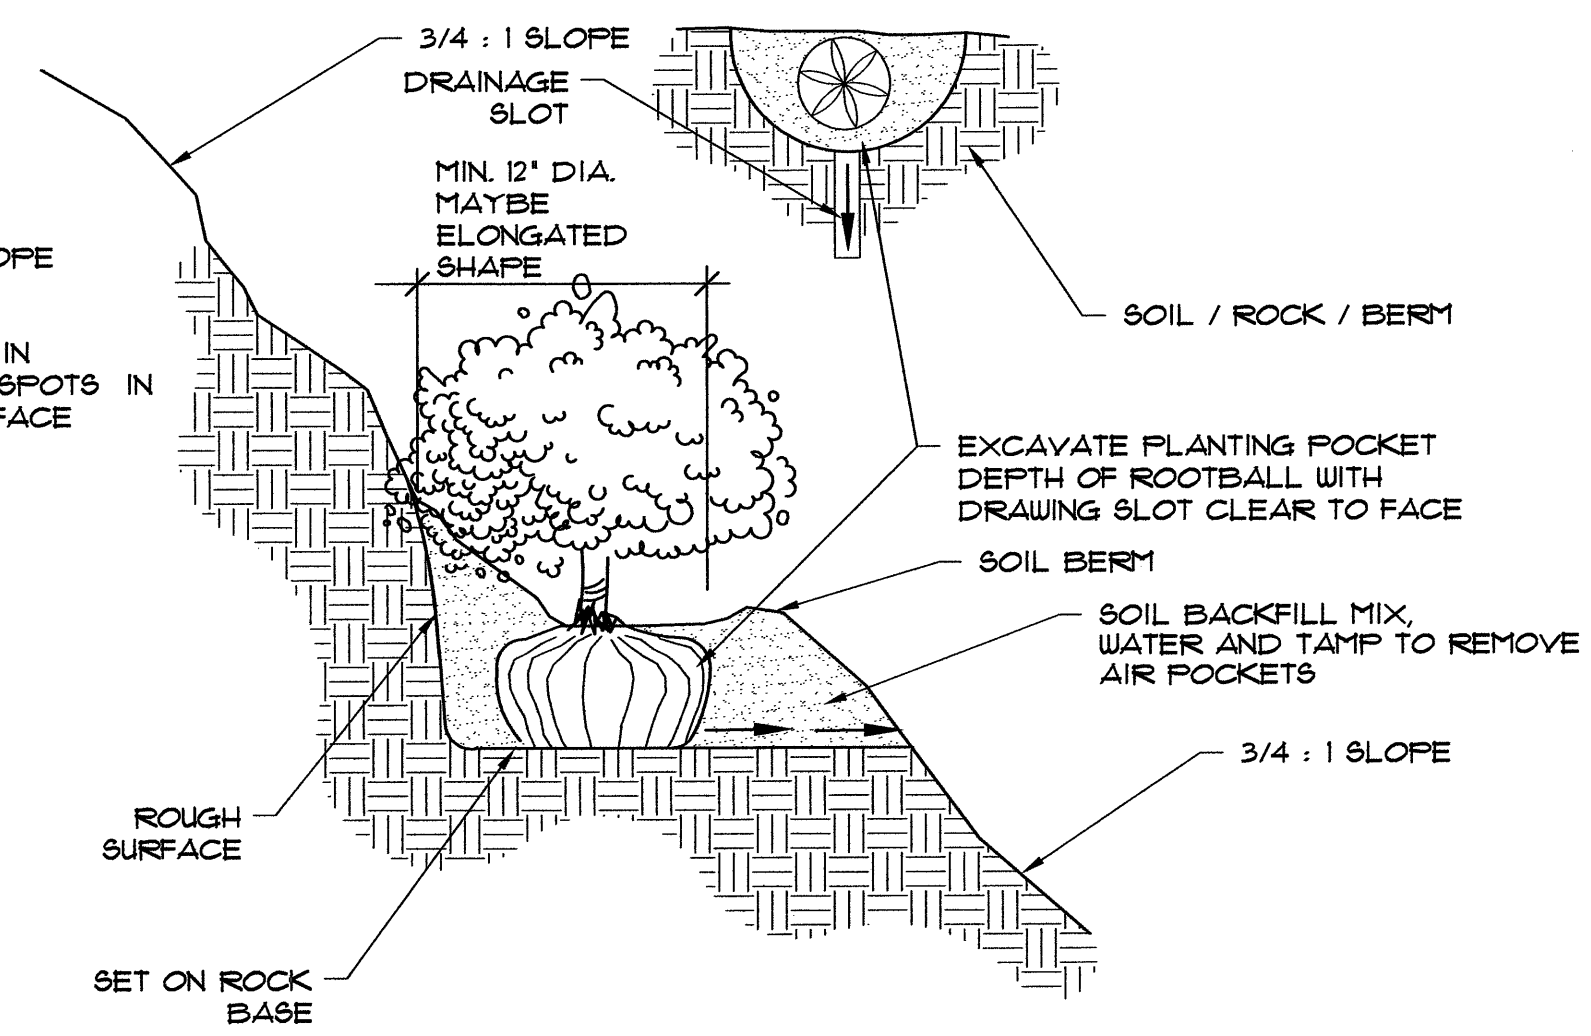
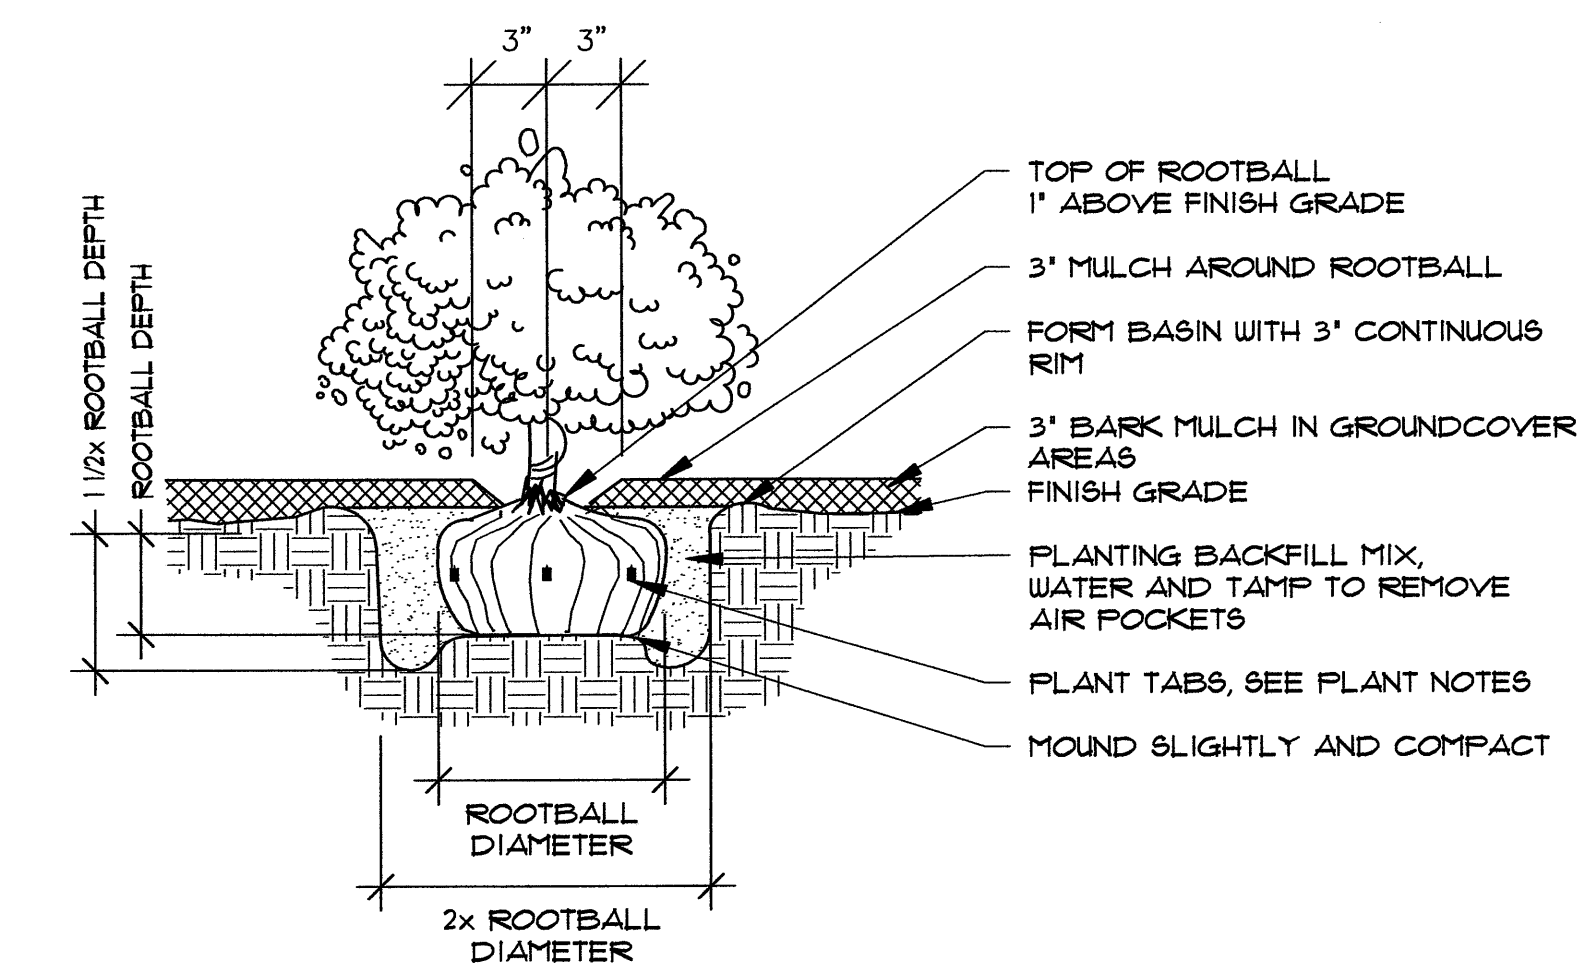
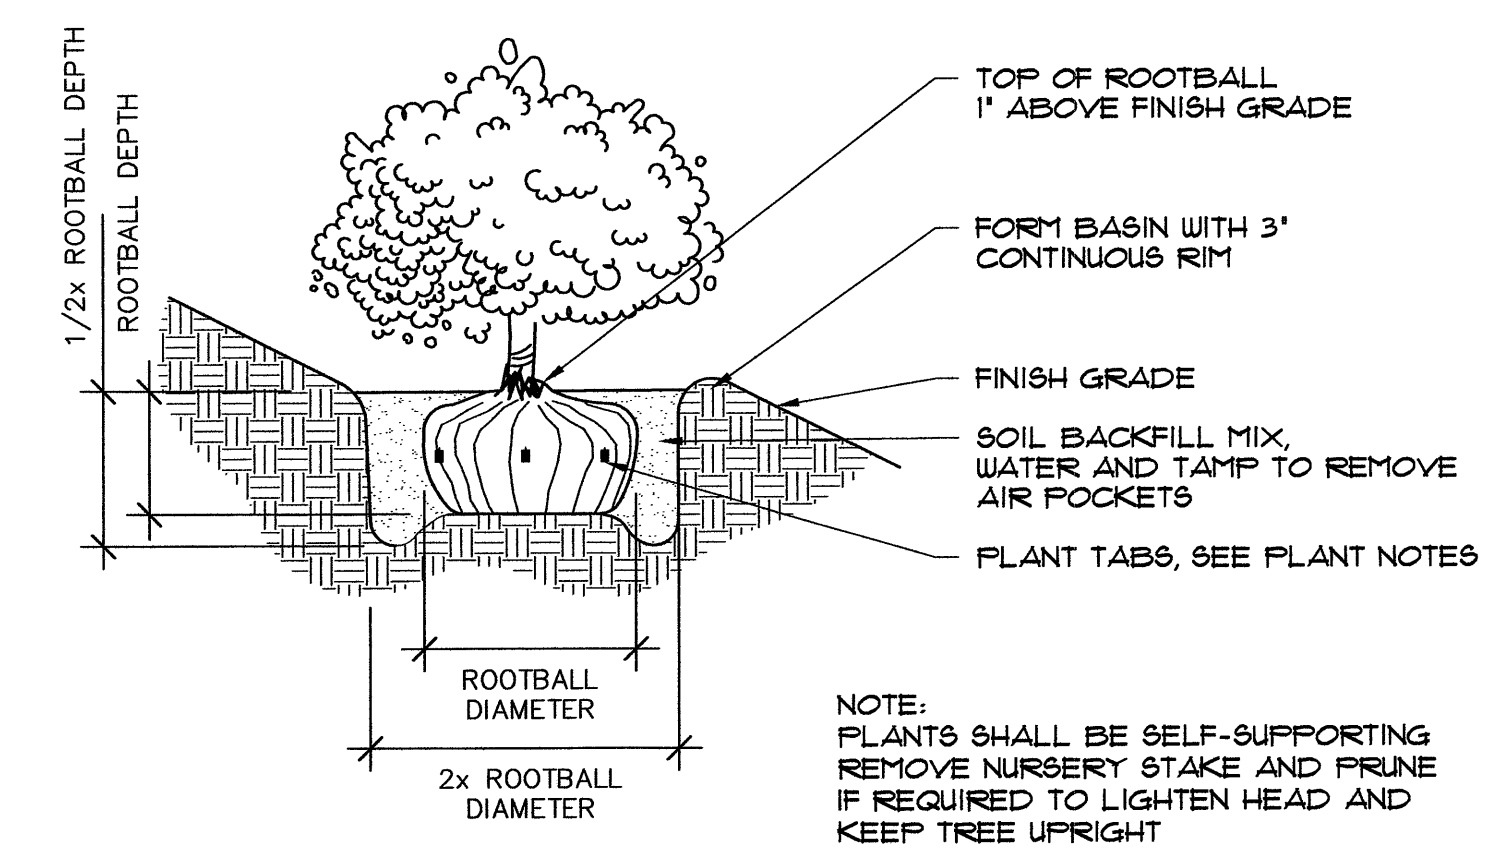
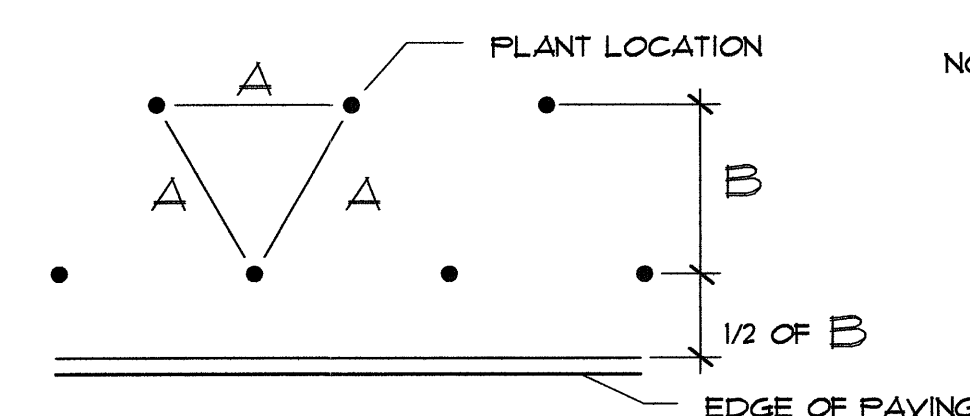


A diagram showing a 4x5 grid of stadium seats. A vertical pipe runs through the center of the grid, with a valve symbol (a circle with a cross) located between the second and third rows. The pipe ends in a T-junction at the bottom, with the text "TO REMOTE CONTROL VALVE" written next to it. Each seat is represented by a rounded rectangle with a small cluster of lines and circles on its backrest, suggesting a headrest or ventilation system.

SPACING 'A'	SPACING 'B'	NO. OF PLANTS/SQ. FT.
6' O.C.	5.20'	4.60
8' O.C.	6.33'	2.60
9' O.C.	7.19'	1.78
10' O.C.	8.66'	1.66
12' O.C.	10.40'	1.15
15' O.C.	13.00'	0.738
18' O.C.	15.60'	0.512
24' O.C.	20.80'	0.290
30' O.C.	26.00'	0.185
36' O.C.	30.00'	0.116

[illegible]

SAN DIEGO GAS & ELECTRIC COMPANY				
SAN DIEGO, CALIFORNIA				
SUNCREST SUBSTATION				
PLANTING LEGEND, DETAILS AND NOTES				
DRAWN BY:	K.N.	DATE:	3/24/10	SCALE: NTS
CHECKED BY:	S.M.	DATE:	3/24/10	W.O.: - REV.: -
APPROVED BY:	V.E.	DATE:	3/24/10	SHEET 25 OF 27
CAD NO.:	S11-04	PILOT SCALE:	1:1	SCR-C-125